

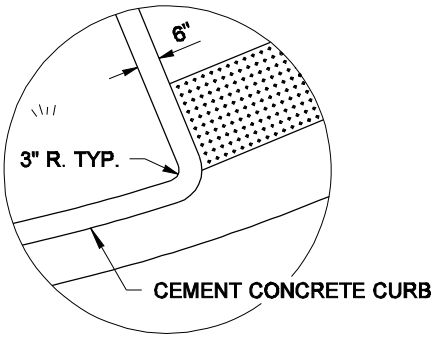
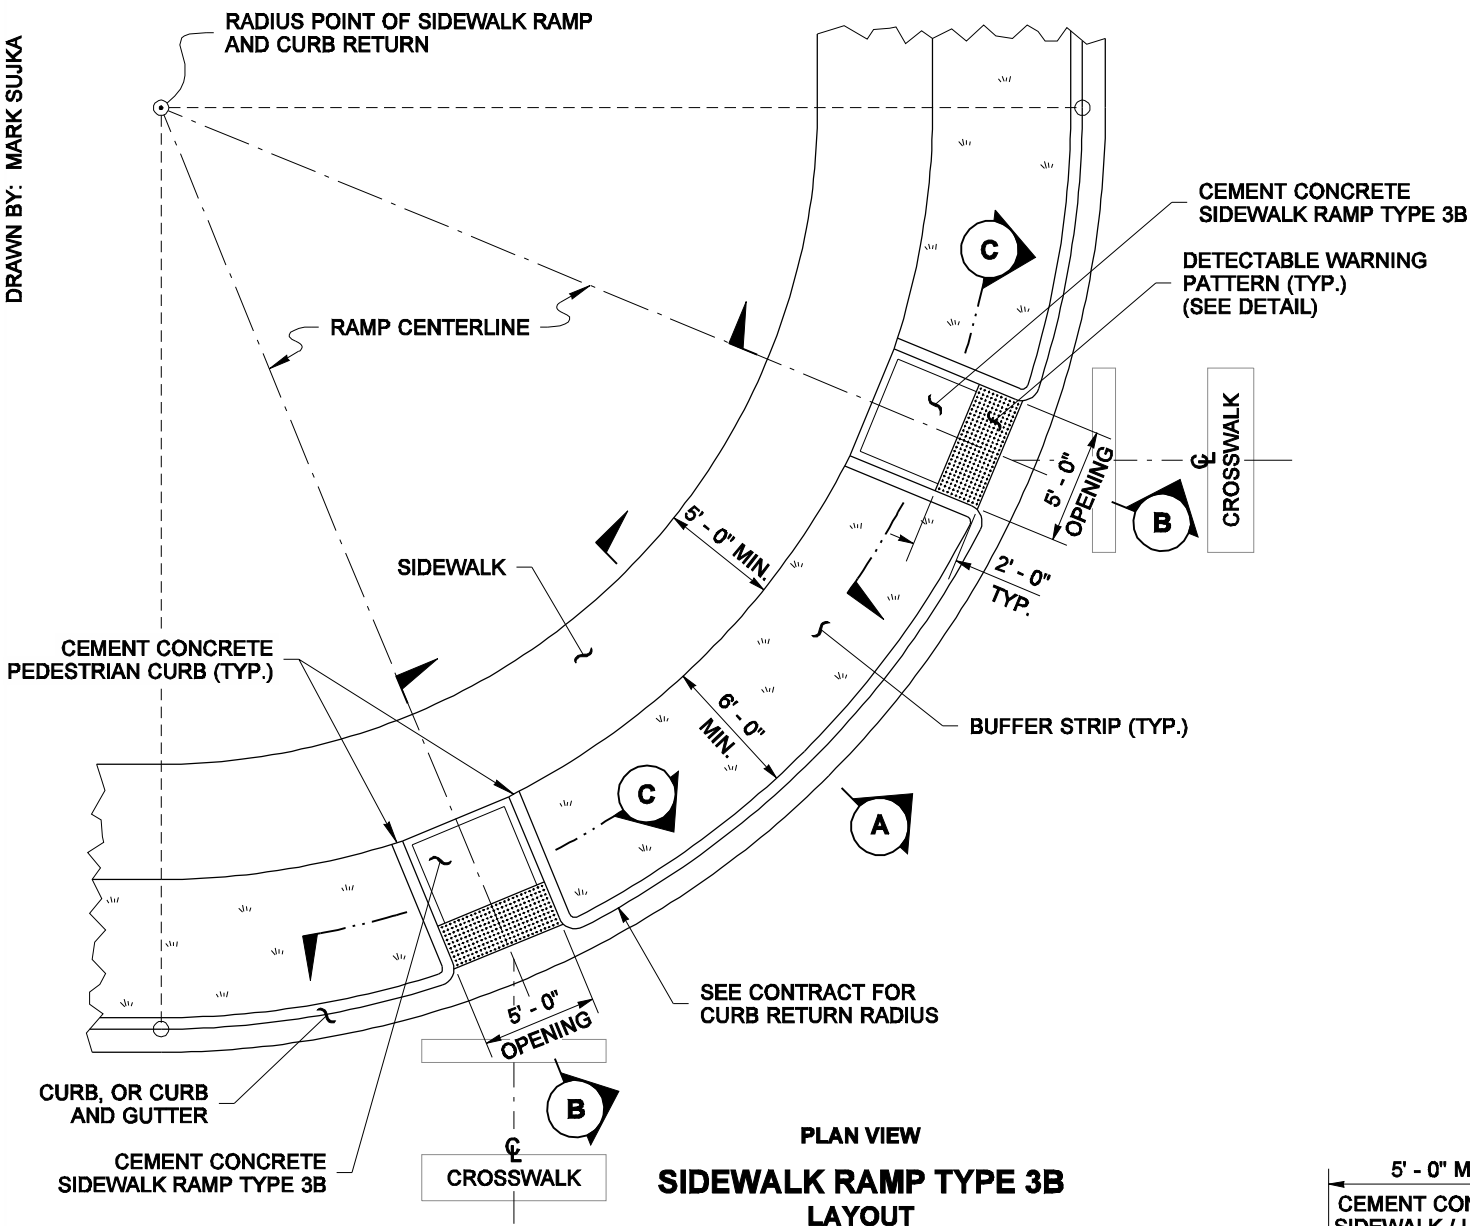
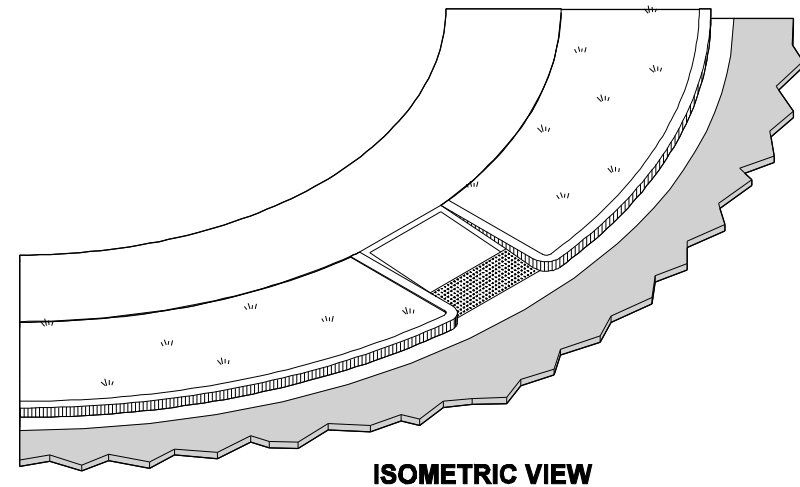
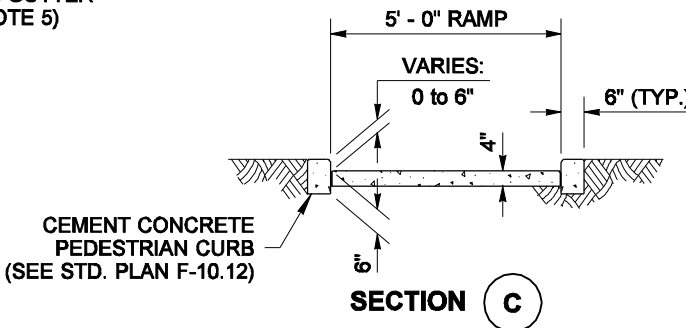
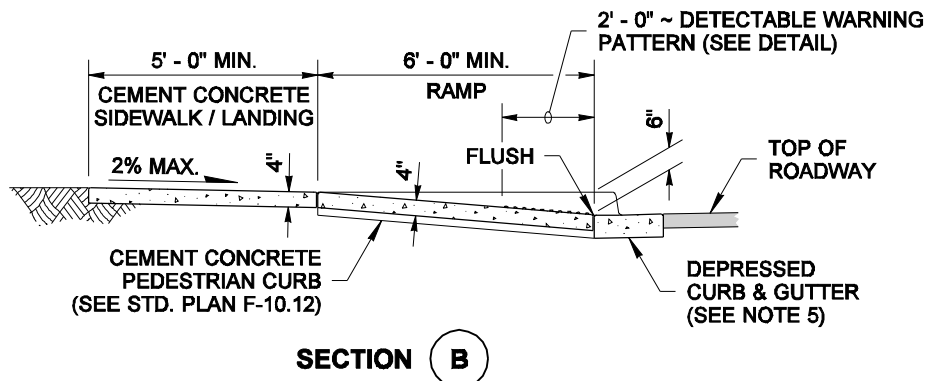


DRAWN BY: MARK SUJKA

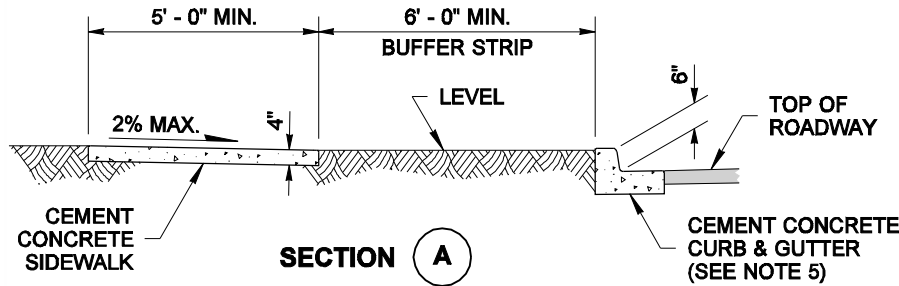

**NOTES**

1. The bottom of the ramp shall have a level area (not in excess of 2% in any direction), 4' x 4'.
2. The Type 3B Ramp Layout requires two (2) of this bid item: "Cement Conc. Sidewalk Ramp Type 3B". The bid item does not include the adjacent Curb (or Curb & Gutter), the Sidewalk between Ramps, or the Cement Conc. Pedestrian Curb.
3. Ramp slopes shall not be steeper than 12H:1V.
4. Avoid placing drainage structures, junction boxes or other obstructions in front of ramp access areas.
5. Curb & Gutter is shown, see the Contract Plans for the curb design specified. See Standard Plan F-10.12 for curb details.
6. See Std. Plan F-30.10 for sidewalk joint placement and details.

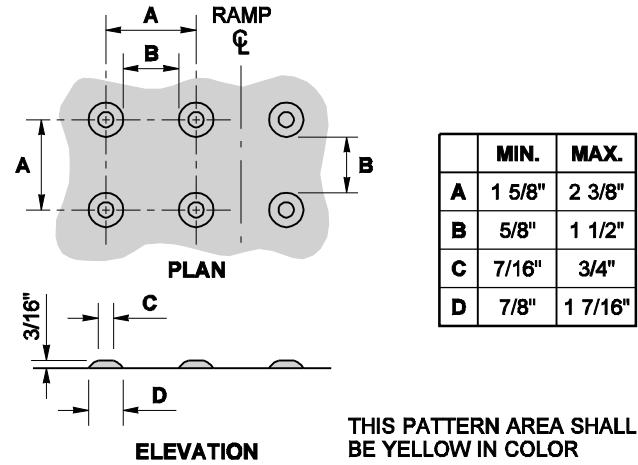

EXPIRES AUGUST 26, 2007

**SIDEWALK RAMP TYPE 3B  
WITH LAYOUT  
STANDARD PLAN F-40.15-00**

SHEET 1 OF 1 SHEET

APPROVED FOR PUBLICATION

**Ken L. Smith**  
STATE DESIGN ENGINEER

**02-07-07**  
DATE



Washington State Department of Transportation

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT. THE ENGINEER'S SEAL AND SIGNATURE ARE REQUIRED FOR THE PLAN TO BE USED FOR CONSTRUCTION. THE PLAN IS THE PROPERTY OF THE WASHINGTON STATE DEPARTMENT OF TRANSPORTATION. A COPY MAY BE OBTAINED UPON REQUEST.